




NECA 402-2014

Standard for

Installing and Maintaining Motor Control Centers

AN AMERICAN NATIONAL STANDARD

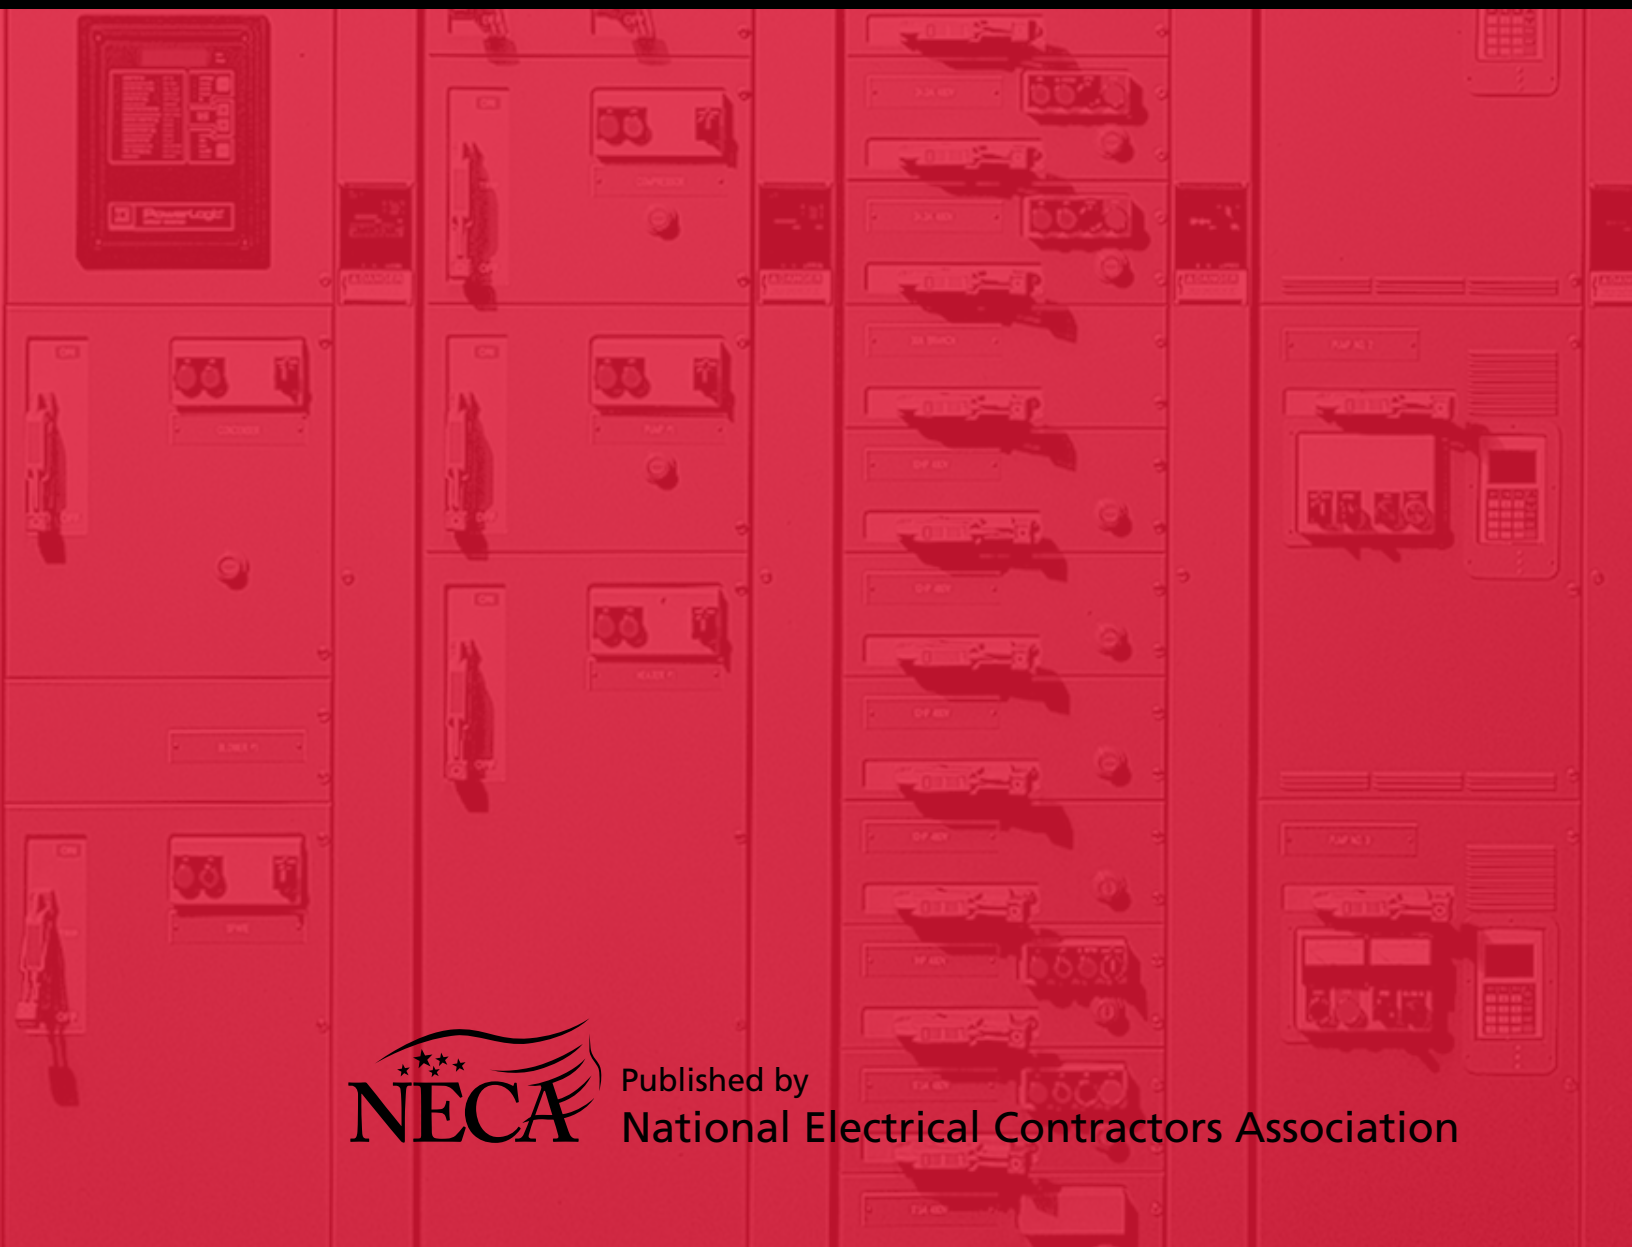

Published by
National Electrical Contractors Association


NECA 402-2014

Standard for

Installing and Maintaining Motor Control Centers

**An American
National Standard**

NEIS



Published by
National Electrical
Contractors Association



Revision History	
NECA 402-2000 originally published	12/2000
NECA 402-2007 revised	07/2007
NECA 402-2014 revised	09/2014

NOTICE OF COPYRIGHT

This document is copyrighted by NECA

Reproduction of these documents either in hard copy or soft (including posting on the web) is prohibited without copyright permission. For copyright permission to reproduce portions of this document, please contact NECA Standards & Safety at (301) 215-4549, or send a fax to (301) 215-4500.

OR

National Electrical Contractors Association
3 Bethesda Metro Center, Suite 1100
Bethesda, MD 20814
(301) 657-3110

Table of Contents

- Foreword.....v**
- 1. Scope 1**
 - 1.1 Products and Applications Included.....1
 - 1.2 Regulatory and Other Requirements1
- 2. Definitions 2**
- 3. Safety Procedures 3**
 - 3.1 General3
 - 3.2 Safe Work Practices3
 - 3.3 De-energizing Electrical Equipment4
- 4. Delivery, Handling, and Storage 5**
 - 4.1 Delivery5
 - 4.2 Handling5
 - 4.3 Storage6
- 5. Site Preparation 8**
 - 5.1 Location8
 - 5.2 Foundation Preparation8
- 6. Installation..... 10**
 - 6.1 General10
 - 6.2 Installing Vertical Sections10
 - 6.3 Joining and Anchoring Motor Control Center Sections11
 - 6.4 Electrical Interconnections Between Vertical Sections11
 - 6.5 Grounding and Bonding12
 - 6.6 Installing Conduits14
 - 6.7 Installing Cables and Conductors14
 - 6.8 Terminating Conductors14
 - 6.9 Busway Connections15
 - 6.10 Installing Motor Control Units15
- 7. Closing Equipment..... 16**
 - 7.1 Clean-up16
 - 7.2 Inspections and Adjustments16
 - 7.3 Insulation Resistance Testing16
 - 7.4 Circuit Breakers and Fusible Switches17
 - 7.5 Ground-Fault Protection Systems18

- 7.6 Final Checks 18
- 8. Energizing Equipment 19**
 - 8.1 General 19
 - 8.2 Energizing Motor Control Centers and Equipment 19
 - 8.3 Operating and Maintenance Manuals 20
- 9. Maintenance 21**
 - 9.1 Frequency of Inspections and Maintenance 21
 - 9.2 Routine Inspections 22
 - 9.3 Cleaning 22
 - 9.4 Inspection, Maintenance, and Testing 23
 - 9.5 Electrical Testing 29
 - 9.6 Re-energizing Motor Control Centers 29
- 10. Adverse Circumstances 30**
 - 10.1 Inspection Following a Short Circuit or Ground-fault Condition 30
 - 10.2 Replacing or Reconditioning a Motor Control Center Submerged in or Soaked by Water 31
 - 10.3 Inspecting and Re-energizing a Motor Control Center Sprayed or Splashed with Clean Water 31
- 11. Motor Control Center Insulation Resistance Chart 33**
- Annex A: Reference Standards 34**