


Elastomers for Waterworks: Pipes, Valves, and Fittings

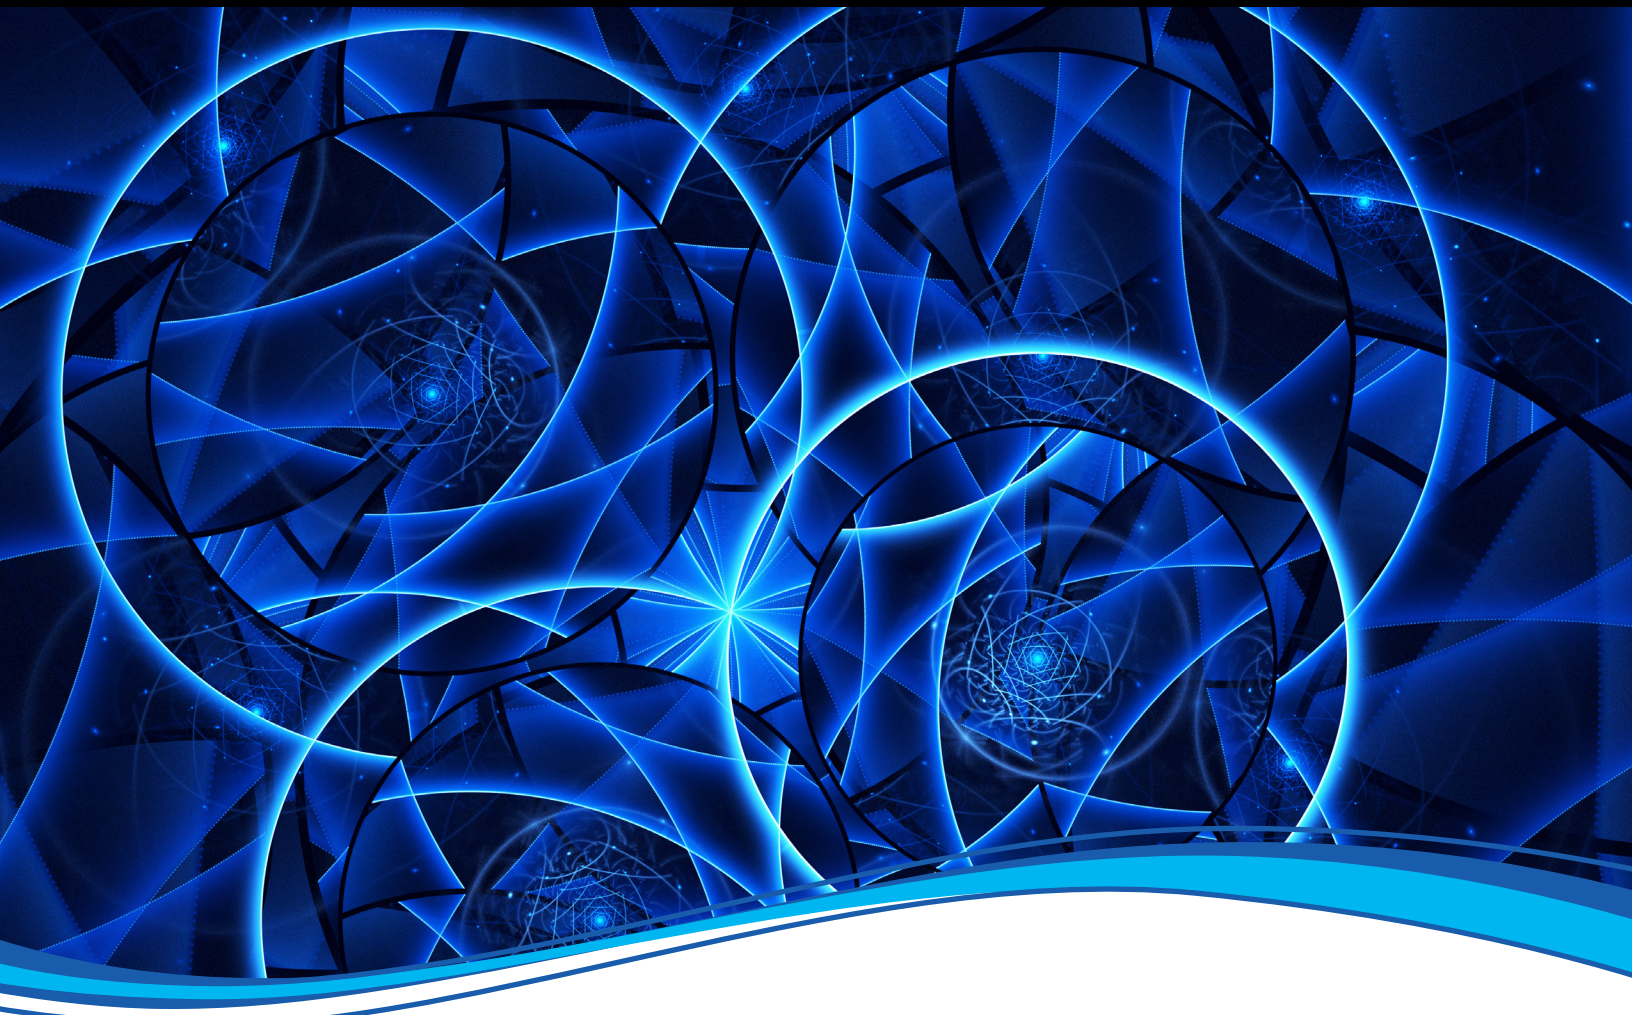

American Water Works
Association

Elastomers for Waterworks: Pipes, Valves, and Fittings

First Edition



**American Water Works
Association**

Manual of Water Supply Practices—M75, First Edition

Elastomers for Waterworks: Pipes, Valves, and Fittings

Copyright © 2020 American Water Works Association

All rights reserved. No part of this publication may be reproduced or transmitted in any form or by any means, electronic or mechanical, including photocopy, recording, or any information or retrieval system, except in the form of brief excerpts or quotations for review purposes, without the written permission of the publisher.

Disclaimer

The authors, contributors, editors, and publisher do not assume responsibility for the validity of the content or any consequences of its use. In no event will AWWA be liable for direct, indirect, special, incidental, or consequential damages arising out of the use of information presented in this book. In particular, AWWA will not be responsible for any costs, including, but not limited to, those incurred as a result of lost revenue. In no event shall AWWA's liability exceed the amount paid for the purchase of this book.

If you find errors in this manual, please email books@awwa.org.
Possible errata will be posted at www.awwa.org/M75.

Managing Editor/Project Manager: Melissa Valentine
Technical Editor: Melissa Valentine
Cover Design/Technical Illustrations: Mike Labruyere
Manager, Publishing Operations: Gillian Wink
Production: Innodata
Senior Specialist - Manuals: Willadee Hitchcock
Manuals Coordinator 2: Janet Greifinger

Library of Congress Cataloging-in-Publication Data


Names: Ballun, John V. | American Water Works Association, issuing body.
Title: M75 - elastomers for waterworks : pipes, valves, and fitting / by John Ballun.
Other titles: Elastomers for waterworks : pipes, valves, and fitting
Description: First edition. | Denver, CO : American Water Works Association, 2020. | Includes bibliographical references and index. |
Summary: "This manual presents the history and general application of elastomers in waterworks pipes, valves, and fittings. The principles used for evaluating, selecting, testing, and maintaining various seals will be presented"-- Provided by publisher.
Identifiers: LCCN 2020021167 | ISBN 9781647170042 (paperback)
Subjects: LCSH: Elastomers--Handbooks, manuals, etc.
Classification: LCC TS1925 .B24 2020 | DDC 628.1028/4--dc23
LC record available at <https://lcn.loc.gov/2020021167>

Printed in the United States of America

ISBN 978-1-64717-004-2

eISBN 978-1-61300-547-7

DOI <https://doi.org/10.12999/AWWA.M75ed1>

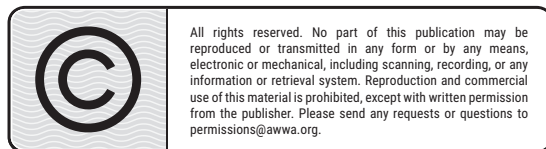

**American Water Works
Association**

American Water Works Association
6666 West Quincy Avenue
Denver, CO 80235-3098
awwa.org

Contents

List of Figures, v	
List of Tables, vii	
Preface, ix	
Acknowledgments, xi	
Chapter 1 Introduction	1
History, 2	
Purpose, 3	
General Definitions, 4	
References, 5	
Chapter 2 Use of Elastomers	7
Linings and Coatings, 7	
Static Seals, 8	
Dynamic Seals, 14	
Diaphragms, 17	
References, 18	
Chapter 3 Types and Manufacture of Elastomers	19
Types of Elastomers, 19	
Selection of Elastomers, 24	
Manufacture of Seals and Gaskets, 25	
Manufacturing Considerations, 30	
References, 31	
Chapter 4 Mechanical Properties of Elastomers	33
Composition, 33	
Safety, 35	
Strength, 36	
Resilience and Tear Resistance, 40	
Temperature Resistance, 42	
Test Protocols, 44	
References, 45	
Chapter 5 Chemical Resistance of Elastomers	47
Elastomer Chemistry, 47	
Drinking Water Compliance, 49	
Chlorine and Chloramine Disinfectants, 50	
Elastomer Degradation Trends, 51	
Permeation of Elastomers, 54	
Chemical Resistance Guides, 55	
Conclusion, 59	
References, 59	

Chapter 6	Storage and Maintenance of Elastomers	61
	Storage and Handling, 61	
	Lubrication and Maintenance, 62	
	Inspection, 62	
Appendix A	Table of Physical/Mechanical Properties of Gaskets for Various Pipe Material Standards	65
Appendix B	Elastomer Test Protocols	71
	Index, 75	
	List of AWWA Manuals, 79	

Figures



- 1-1 Various elastomeric seals for the waterworks industry, 3
- 2-1 Check valve with rubber-lined interior and flange facing, 8
- 2-2 Resilient wedge gate valve with O-ring seal and rubber encapsulated wedge, 8
- 2-3 O-ring installation without and with pressure (P), 9
- 2-4 Typical waterworks flange, 10
- 2-5 Waterworks check valve flange connection with full-face gasket, 10
- 2-6 Sample full-face and ring-type gaskets, 11
- 2-7 PVC pipe push-on joint, 12
- 2-8 Ductile iron pipe push-on joint, 12
- 2-9 Steel pipe flanged and grooved joints, 13
- 2-10 Butt fusion of PE pipe, 13
- 2-11 Electrofusion coupling for PE pipe, 13
- 2-12 Mechanical joint adapter for PE pipe, 13
- 2-13 Mechanical joint connection, 14
- 2-14 Air/vacuum valve, 15
- 2-15 Typical dynamic seal in a dry-barrel fire hydrant, 15
- 2-16 Typical bolted resilient seat in AWWA butterfly valve, 15
- 2-17 Typical epoxy-retained resilient seats in AWWA butterfly valve, 15
- 2-18 Example of a knife gate valve, 16
- 2-19 Typical V-packing set in an AWWA butterfly valve, 17
- 2-20 Pinch valve, 17
- 2-21 Globe control valve with diaphragm, 17
- 3-1 Rubber ingredients loaded between two rollers for mixing, 26
- 3-2 Rubber lining on the interior of a butterfly valve body, 26
- 3-3 Typical rubber molding press with electric heating, 27
- 3-4 Typical transfer molding process, 28
- 3-5 Typical injection molding process, 28
- 3-6 Samples of molded rubber parts, 29
- 3-7 Fabrication of seals using an extrusion die, 29
- 3-8 Rheometer fixture, 30
- 4-1 Single monomer of natural rubber, 34
- 4-2 Vulcanization of natural rubber with sulfur, 34
- 4-3 Composition of NBR (nitrile), 34
- 4-4 Sample NSF/ANSI/CAN 61 online certification, 37
- 4-5 Durometer device (A scale), 38

- 4-6 Various durometer scales, 38
- 4-7 Elastomer test specimen, 39
- 4-8 Tension testing machine, 39
- 4-9 Compression set apparatus, 41
- 4-10 Tear resistance test specimens, 42
- 4-11 Typical operating temperature range of various elastomers, 43
- 4-12 Durometer of elastomers at reduced temperatures, 43

- 5-1 Elastomer degradation of a check valve disc in potable water service, 48
- 5-2 Degradation of a resilient gate valve wedge in service, 51

- 6-1 Surface degradation of an elastomeric part, 63
- 6-2 Portable rubber hardness tester, 63

Tables



- 2-1 Waterworks flange and fittings standards, 10
- 3-1 Example formulation for SBR compound (PHR = parts per hundred in rubber by weight), 22
- 3-2 ASTM D2000 definitions of material types and classes, 23
- 3-3 Common elastomers and generic properties, 24
- 4-1 Common ingredients of elastomers and their functions, 35
- 4-2 Required properties for a push-on pipe gasket, 37
- 4-3 Typical heat aging test variation for NBR (ASTM D2000), 44
- 4-4 Summary of standard elastomer tests, 45
- 5-1 Bond disassociation energy of common bonds, 49
- 5-2 Susceptibility of elastomers without antidegradants to chloramine attack, 52
- 5-3 Degradation of various generic elastomers without antidegradants in chloramine service, 53
- 5-4 Chemical resistance guide, 56
- A-1 Physical/mechanical properties of gaskets for plastic, ductile iron, steel, and clay pipe, 66
- A-2 Physical/mechanical properties of gaskets for concrete pressure pipe, 67
- A-3 Physical/mechanical properties of gaskets for concrete gravity pipe, 68

This page intentionally blank.

Preface

This manual presents the history and general application of elastomers in waterworks pipes, valves, and fittings. The principles used for evaluating, selecting, testing, and maintaining various seals will be presented. It is a discussion of recommended practice, not an American Water Works Association (AWWA) standard. This document provides guidance on generally available elastomers and products and their application. Questions about specific situations or applicability to specific valves or fittings should be directed to the manufacturer or supplier.

Information contained in this manual is useful for operators, technicians, and engineers for gaining a basic understanding of the use and selection of elastomers. There are many special materials that are beyond the scope of this manual and require special consultations with suppliers and manufacturers. The elastomer properties and resistance data are generic, and actual data from the intended valve and fitting manufacturer should be obtained before making the final selection of an elastomer. This manual provides information on elastomers used in many AWWA Standards, including the following:

- AWWA C110, Ductile-Iron and Gray-Iron Fittings
- AWWA C111, Rubber-Gasket Joints for Ductile-Iron Pressure and Fittings
- AWWA C115, Flanged Ductile-Iron Pipe with Ductile-Iron or Gray-Iron Threaded Flanges
- AWWA C151, Ductile Iron Pipe, Centrifugally Cast
- AWWA C153, Ductile Iron Compact Fittings
- AWWA C200, Steel Water Pipe, 6 In. (150 mm) and Larger
- AWWA C207, Steel Pipe Flanges for Waterworks Service, Sizes 4 In. Through 144 In. (100 mm Through 3,600 mm)
- AWWA C221, Fabricated Steel Mechanical Slip-Type Expansion Joints
- AWWA C223, Fabricated Steel and Stainless-Steel Tapping Sleeves
- AWWA C227, Bolted, Split-Sleeve Couplings
- AWWA C228, Stainless-Steel Pipe Flange Joints for Water Service – Sizes 2 In. Through 72 In. (50 mm Through 1,800 mm)
- AWWA C230, Stainless-Steel Full-Encirclement Repair and Service Connection Clamps for 2-in. Through 12-in. (50-mm Through 300-mm) Pipe
- AWWA C300, Reinforced Concrete Pressure Pipe, Steel-Cylinder Type
- AWWA C301, Prestressed Concrete Pressure Pipe, Steel-Cylinder Type
- AWWA C302, Reinforced Concrete Pressure Pipe, Non-Cylinder Type
- AWWA C303, Concrete Pressure Pipe, Bar-Wrapped, Steel-Cylinder Type
- AWWA C502, Dry-Barrel Fire Hydrants
- AWWA C503, Wet-Barrel Fire Hydrants
- AWWA C504, Rubber Seated Butterfly Valves, 3 In. (75 mm) Through 72 In. (1,800 mm)
- AWWA C507, Ball Valves, 6 In. Through 60 In. (150 mm Through 1,500 mm)
- AWWA C508, Swing-Check Valves for Waterworks Service, 2-In. Through 24-In. (50-mm Through 600-mm) NPS

- AWWA C509, Resilient-Seated Gate Valves for Water Supply Service
- AWWA C510, Double Check-Valve Backflow Prevention Assembly
- AWWA C511, Reduce Pressure Principle Backflow Prevention Assembly
- AWWA C512, Air-Release, Air/Vacuum, and Combination Air Valves for Water and Wastewater Service
- AWWA C515, Reduced Wall, Resilient-Seated Gate Valves for Water Supply Service
- AWWA C516, Large-Diameter Rubber-Seated Butterfly Valves, Sizes 78 In. (2,000 mm) and Larger
- AWWA C517, Resilient-Seated Cast-Iron Eccentric Plug Valves
- AWWA C518, Double-Disc Swing Check Valves for Waterworks Service, 2-In. Through 48-In. (50-mm Through 1200-mm) NPS
- AWWA C519, High Performance Waterworks Butterfly Valves – 3 In. (75 mm) Through 60 In. (1,500 mm)
- AWWA C520, Knife Gate Valves, Sizes 2 In. (50 mm) Through 96 In. (2,400 mm)
- AWWA C606, Grooved and Shouldered Joints
- AWWA C900, Polyvinyl Chloride (PVC) Pressure Pipe and Fabricated Fittings, 4 In. Through 60 In. (100 mm Through 1,500 mm)

This manual refers to AWWA standards, which are available for purchase from the AWWA Bookstore by calling (800) 926-7337 or online at www.awwa.org/bookstore.

Manufacturers graciously provided illustrations and other documentation. AWWA does not endorse any manufacturer's products, and the names of the manufacturers have been removed from the material provided.

Metrification Note: Valve and fitting sizes are listed in their current US designation— inches. To obtain an approximate metric equivalent, use a conversion factor of 25.4 mm per inch.

Acknowledgments

The M75 Elastomers Subcommittee, which developed and reviewed this manual, had the following personnel at the time:

John Ballun, *Chair*

J.V. Ballun, Val-Matic Valve & Mfg. Corp., Elmhurst, Ill.
T. Carson, Specification Rubber Products, Inc., Alabaster, Ala.
L.R. Dunn, Bessemer, Ala.
J.A. Fancher, ACIPCO, Birmingham, Ala.
J. Grant, DeZURIK APCO HILTON, Sartell, Minn.
T.C. Harbour, Mueller Co., Decatur, Ill.
J.R. Holstrom, Val-Matic Valve & Mfg. Corp., Addison, Ill.
J.D. Larson, Saint Louis, Mo.
M. MacConnell, Burnaby, B.C.
S. Rahman, BGE Inc., Fort Worth, Tex.
E.S. Ralph, Standards Engineer Liaison, AWWA, Denver, Colo.
T.D. Rockaway, University of Louisville, Louisville, Ky.
D.B. Scott, American Flow Control, Birmingham, Ala.
J.H. Wilber, American AVK, Littleton, Colo.

The AWWA Gasket Materials for Water Works Service Committee, which reviewed and approved this manual, had the following personnel at the time of approval:

Donovan Larson, *Chair*

David Hughes, *Secretary*

General Interest Members

M.S. Alvey, Owensboro, Ky.
J.D. Larson, Saint Louis, Mo.
D.R. Purkiss, NSF International, Ann Arbor, Mich.
S. Rahman, BGE Inc., Fort Worth, Tex.
E.S. Ralph (*liaison, nonvoting*), Standards Engineer Liaison, AWWA, Denver, Colo.
T.D. Rockaway, University of Louisville, Louisville, Ky.
R.F. Williams, AECOM, Miami, Fla.

Producer Members

J.V. Ballun, Val-Matic Valve & Mfg. Corp., Elmhurst, Ill.
T. Carson (*alternate*), Specification Rubber Products, Inc., Alabaster, Ala.
S.E. Cooper (*nonvoting*), Uni-Bell PVC Pipe Association, Louisville, Ky.
L.R. Dunn (*alternate*), Besemer, Ala.
P. Gifford (*nonvoting*), Mueller Co., Chattanooga, Tenn.
T. Heartwell (*nonvoting*), VSP Technologies, Prince George, Va.
D.A. Hughes, US Pipe and Foundry, Bessemer, Ala.
K. Johnson (*nonvoting*), M & H Valve Co., Anniston, Ala.
R.L. Larkin (*nonvoting*), J & S Valve, Gardendale, Ala.
L. Mattina, Garlock Inc., Palmyra, N.Y.
D.B. Scott, American Flow Control, Birmingham, Ala.
J.H. Wilber, American AVK, Littleton, Colo.

User Members

A. Bodulow, Los Angeles Water & Power, Los Angeles, Calif.
M. Garcia (*liaison, nonvoting*), Standards Council Liaison, Denver Water,
Denver, Colo.
S. Hattan, Tarrant Regional Water District, Fort Worth, Tex.
M.P. Jaspering, Missouri American Water, St. Louis, Mo.
M. MacConnell, Burnaby, B.C.
M. Spinner, Denver Water, Denver, Colo.
E. Walls, Louisville Water, Louisville, Ky.

Chapter **1**

Introduction

Elastomeric linings, gaskets, diaphragms, and seals play an essential role in the operation of water distribution systems. They are used in pipes, valves, and fittings to provide tight seals for joints and valve closure members under various operating parameters including pressure, temperature, and chemical environments. There are no defining industry or AWWA material standards for specific elastomers used in the waterworks industry. Therefore, it is important to understand the chemistry, properties, and test methods associated with elastomers when selecting and specifying their use.

All materials can degrade while in service. The physical changes due to the environment, ultraviolet light exposure, wear, corrosion, chemical compatibility, fatigue, and temperature are understood for most metallic components. For elastomers, these changes are not as well cataloged and understood and can be substantially different for various and combined service conditions. Degradation and other property changes can impact expected service life and preventive maintenance frequencies. Because elastomers have different rates of degradation, the intended service life and operational compatibility are always important for proper elastomer selection.

A marked change occurred in the US waterworks industry in the 1980s when many water utilities changed from chlorine to chloramine disinfection to meet new trihalomethane (THM) standards for drinking water. Within a few months of the conversion, Ft. Lauderdale, Fla., reported rubber flappers in toilet tanks breaking down; Topeka, Kans., reported gaskets and diaphragms on backflow prevention assemblies beginning to deteriorate; and in Ingleside, Tex., the seating materials of filter backwash valves failed prematurely. These events led to several studies in the industry to better understand commonly used elastomers and their applications in the waterworks industry (Reiber 1993).

Product application and service history are important factors for elastomer selection. The selection of an elastomer for use as a dynamic seal in a safety-related valve for a nuclear power plant is much more critical than the elastomer used for a residential water heater relief valve. However, components of water systems are expected to perform as designed